


NO.	DATE	BY/CHKD

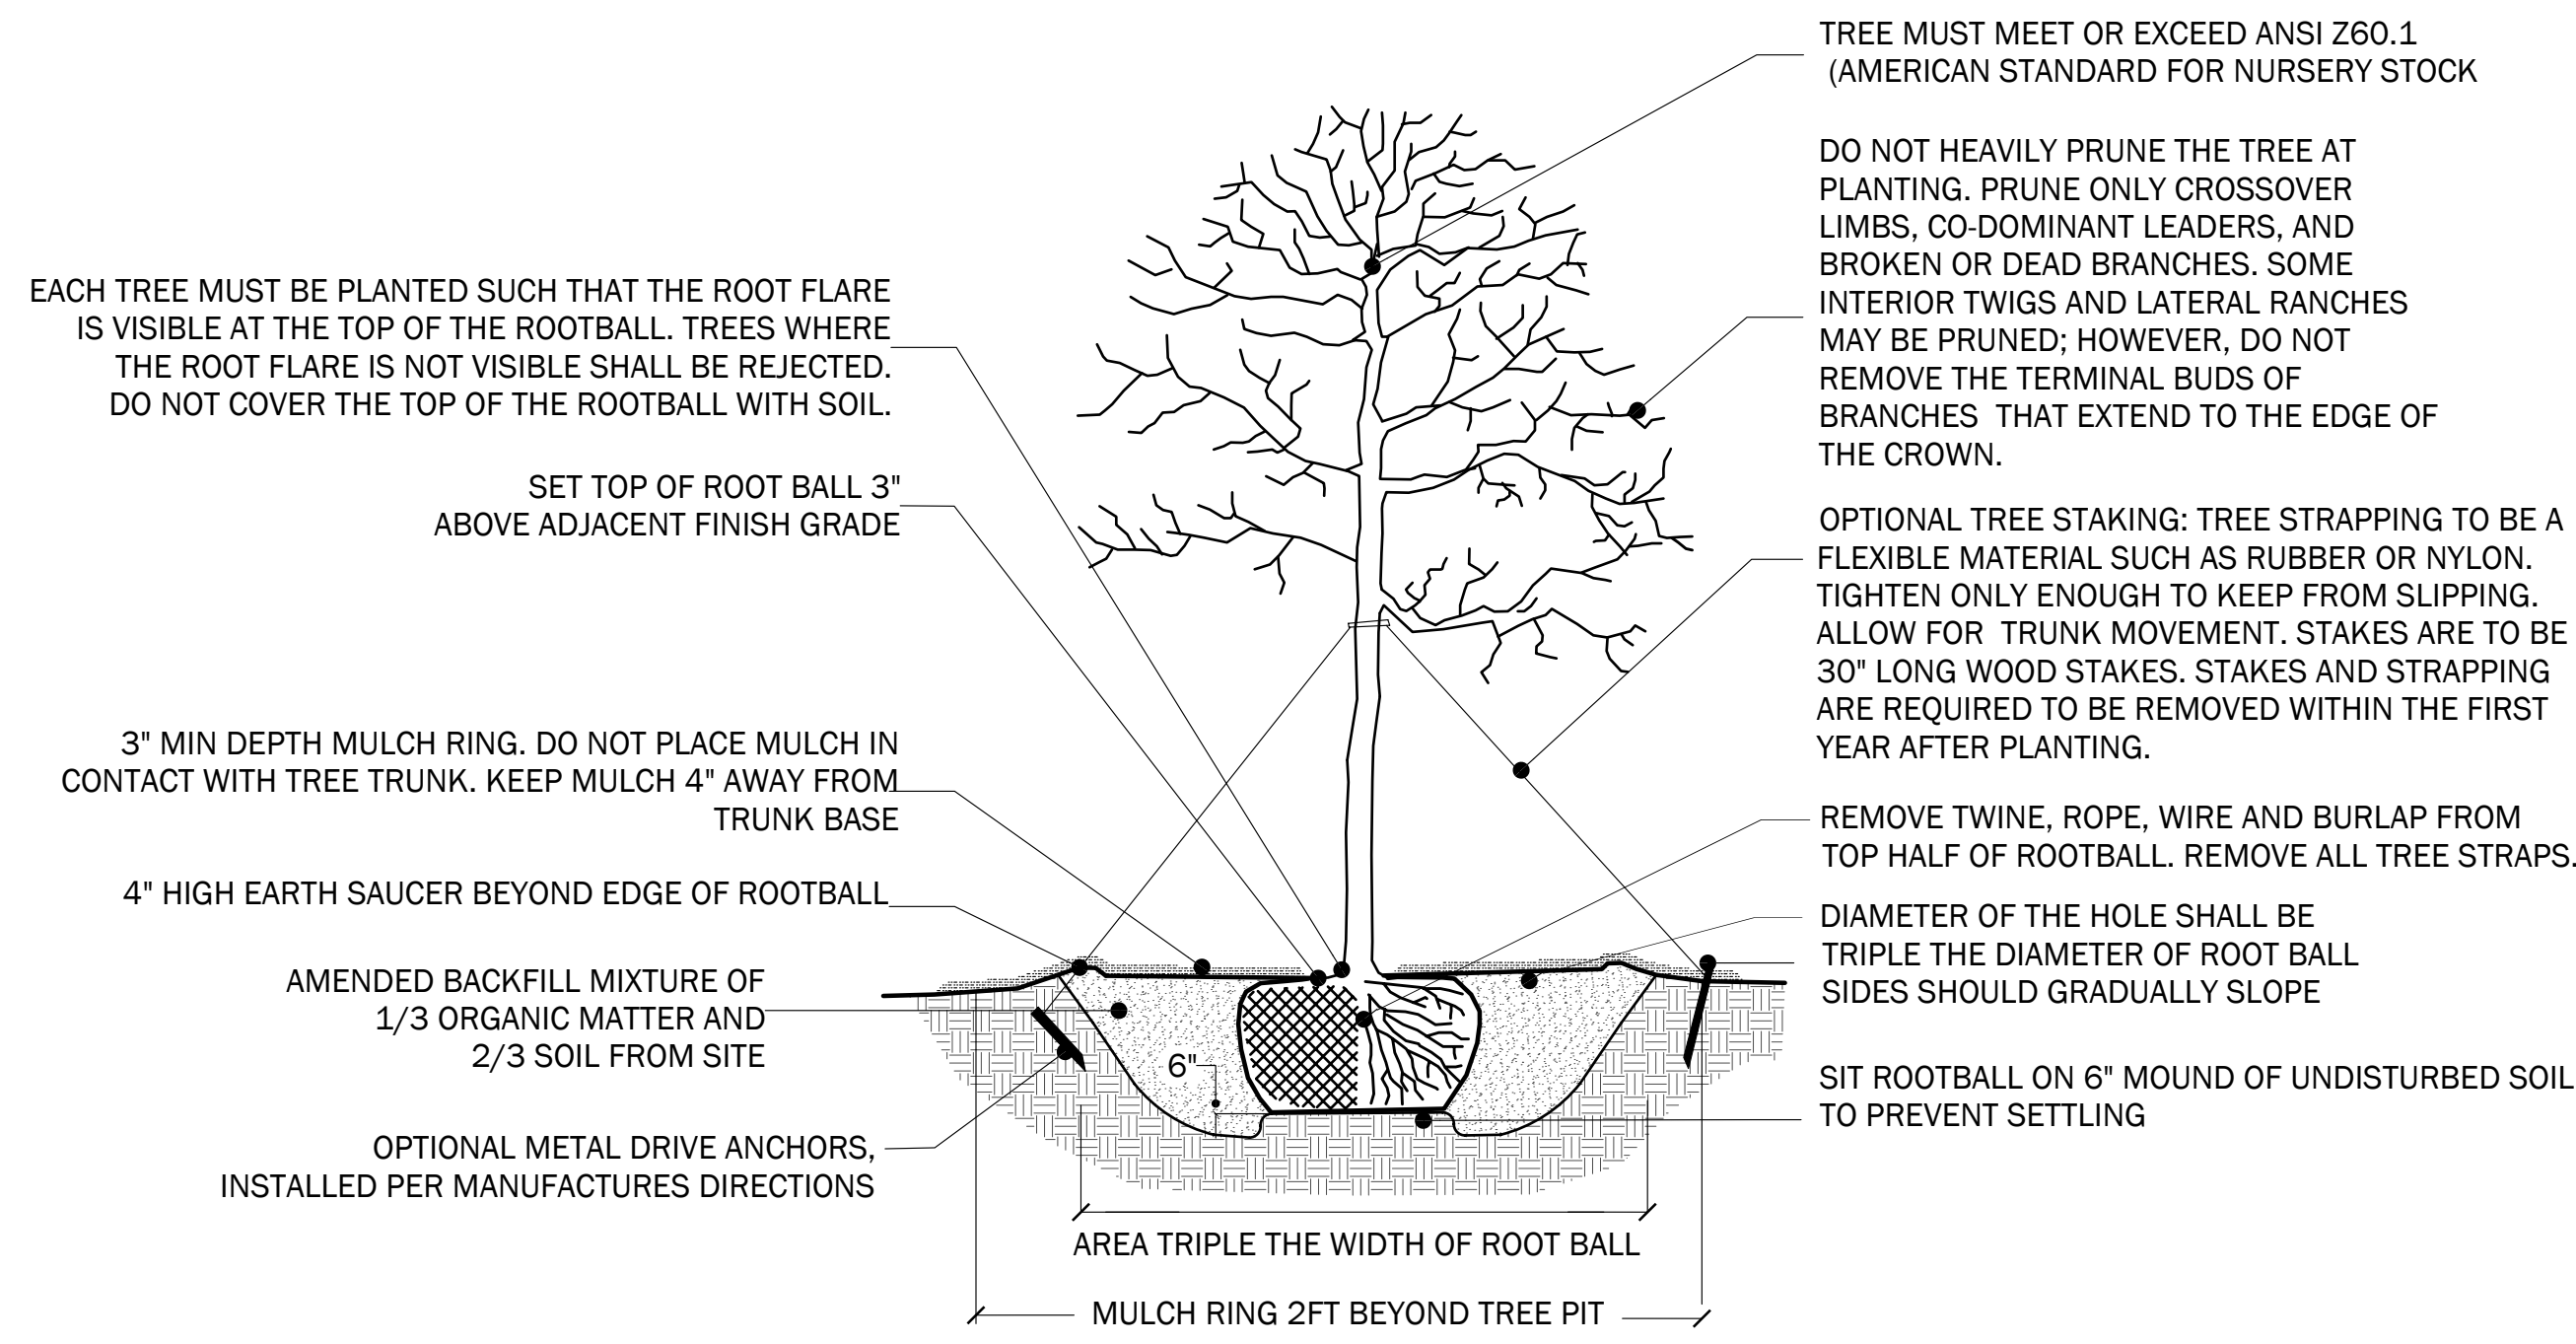

# SECTION: TREE PLANTING DETAIL

CROSS SECTION

TREE MUST MEET OR EXCEED ANSI Z60.1  
(AMERICAN STANDARD FOR NURSERY STOCK)

DO NOT HEAVILY PRUNE THE TREE AT PLANTING. PRUNE ONLY CROSSOVER LIMBS, CO-DOMINANT LEADERS, AND BROKEN OR DEAD BRANCHES. SOME INTERIOR TWIGS AND LATERAL RANCHES MAY BE PRUNED; HOWEVER, DO NOT REMOVE THE TERMINAL BUDS OF BRANCHES THAT EXTEND TO THE EDGE OF THE CROWN.

OPTIONAL TREE STAKING: TREE STRAPPING TO BE A FLEXIBLE MATERIAL SUCH AS RUBBER OR NYLON. TIGHTEN ONLY ENOUGH TO KEEP FROM SLIPPING. ALLOW FOR TRUNK MOVEMENT. STAKES ARE TO BE 30" LONG WOOD STAKES. STAKES AND STRAPPING ARE REQUIRED TO BE REMOVED WITHIN THE FIRST YEAR AFTER PLANTING.

REMOVE TWINE, ROPE, WIRE AND BURLAP FROM TOP HALF OF ROOTBALL. REMOVE ALL TREE STRAPS.

DIAMETER OF THE HOLE SHALL BE TRIPLE THE DIAMETER OF ROOT BALL SIDES SHOULD GRADUALLY SLOPE

SIT ROOTBALL ON 6" MOUND OF UNDISTURBED SOIL TO PREVENT SETTLING

EACH TREE MUST BE PLANTED SUCH THAT THE ROOT FLARE IS VISIBLE AT THE TOP OF THE ROOTBALL. TREES WHERE THE ROOT FLARE IS NOT VISIBLE SHALL BE REJECTED. DO NOT COVER THE TOP OF THE ROOTBALL WITH SOIL.

SET TOP OF ROOT BALL 3" ABOVE ADJACENT FINISH GRADE

3" MIN DEPTH MULCH RING. DO NOT PLACE MULCH IN CONTACT WITH TREE TRUNK. KEEP MULCH 4" AWAY FROM TRUNK BASE

4" HIGH EARTH SAUCER BEYOND EDGE OF ROOTBALL

AMENDED BACKFILL MIXTURE OF 1/3 ORGANIC MATTER AND 2/3 SOIL FROM SITE

OPTIONAL METAL DRIVE ANCHORS, INSTALLED PER MANUFACTURES DIRECTIONS

AREA TRIPLE THE WIDTH OF ROOT BALL

MULCH RING 2FT BEYOND TREE PIT